



CONFIDENTIAL
 THESE PRINTS ARE THE EXCLUSIVE PROPERTY OF KNIGHT, INC. A UNIT OF IDEX. ANY REPRODUCTION OR USE OF INFORMATION FROM THESE PRINTS WITHOUT THE SPECIFIC CONSENT OF KNIGHT, INC. IN WRITING IS PROHIBITED.

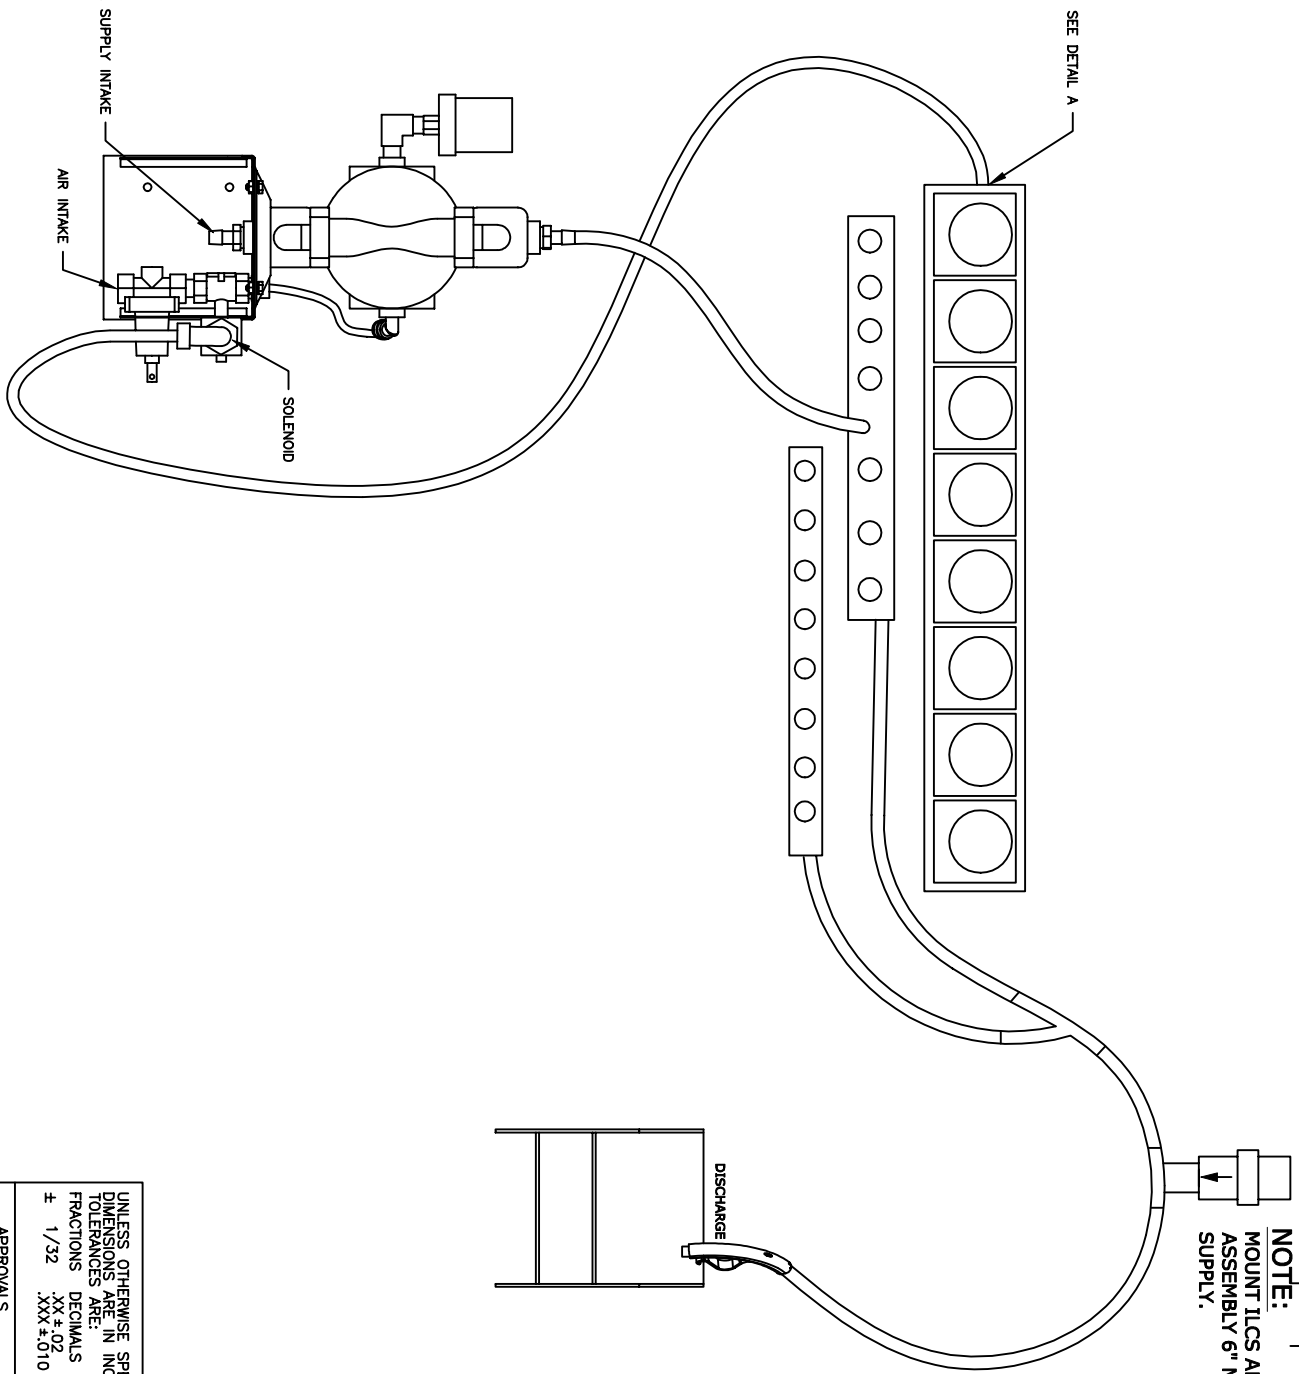

NOTE:
 MOUNT IICS ANTI-SIPHON CHECK VALVE ASSEMBLY 6" MINIMUM ABOVE CHEMICAL SUPPLY.

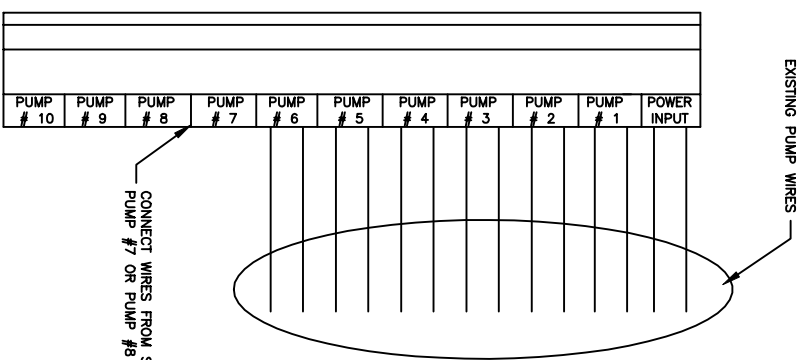

DETAIL A

REVISIONS			
REV.	DESCRIPTION	DATE	APPROVED
REL.	INITIAL RELEASE EO 2970	7 FEB '2K	C.W.

NOTES: UNLESS OTHERWISE SPECIFIED

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		
TOLERANCES ARE:		
FRACTIONS	DECIMALS	ANGLES
± 1/32	.XX ± 0.02	± 1°
	.XXX ± 0.10	
APPROVALS	DATE	
DRAWN A.R. BOUSE	2 FEB 00	
CHECKED C. NESSELROAD	2/8/00	
CHECKED		
MATERIAL		

KNIGHT
 Knight, Inc. A Unit of IDEX Corporation

IDEX
 IDEX Corporation

INSTALLATION GUIDE
SINGLE AOP PUMP

SIZE	REF. NUMBER	PART NO.	REV.
A	7600281	0900601	REL
SCALE NONE	FILE NAME: 0900601	SHEET	1 OF 1